


EXAMPLE "A"

DUAL PROGRAM REQUIRED FOR TWO GENSET TYPE OPERATION.
 PROGRAM 1 - Genset 90kW
 PROGRAM 2 - Genset 155 kW or 2 x 155kw
 CT-1 VALUE = G2 + G3

EXAMPLE "B"

DUAL PROGRAM REQUIRED FOR TWO GENSET TYPE OPERATION.
 PROGRAM 1 - Genset 90kW
 PROGRAM 2 - Genset 155 kW
 CT-1 VALUE = G1 + G2


DATE	REVISION	BY




SEPHCO INDUSTRIES PTY LTD
 Email: sales@sephco.com www.sephco.com

**PROPOSED CT LOCATION
 FOR AUTO LOAD SHEDDING LOAD BANK -DUAL CONTROL
 OPERATION**

DRAWN	CHECKED	SCALE	DRAWING NO.
			SPP 7131

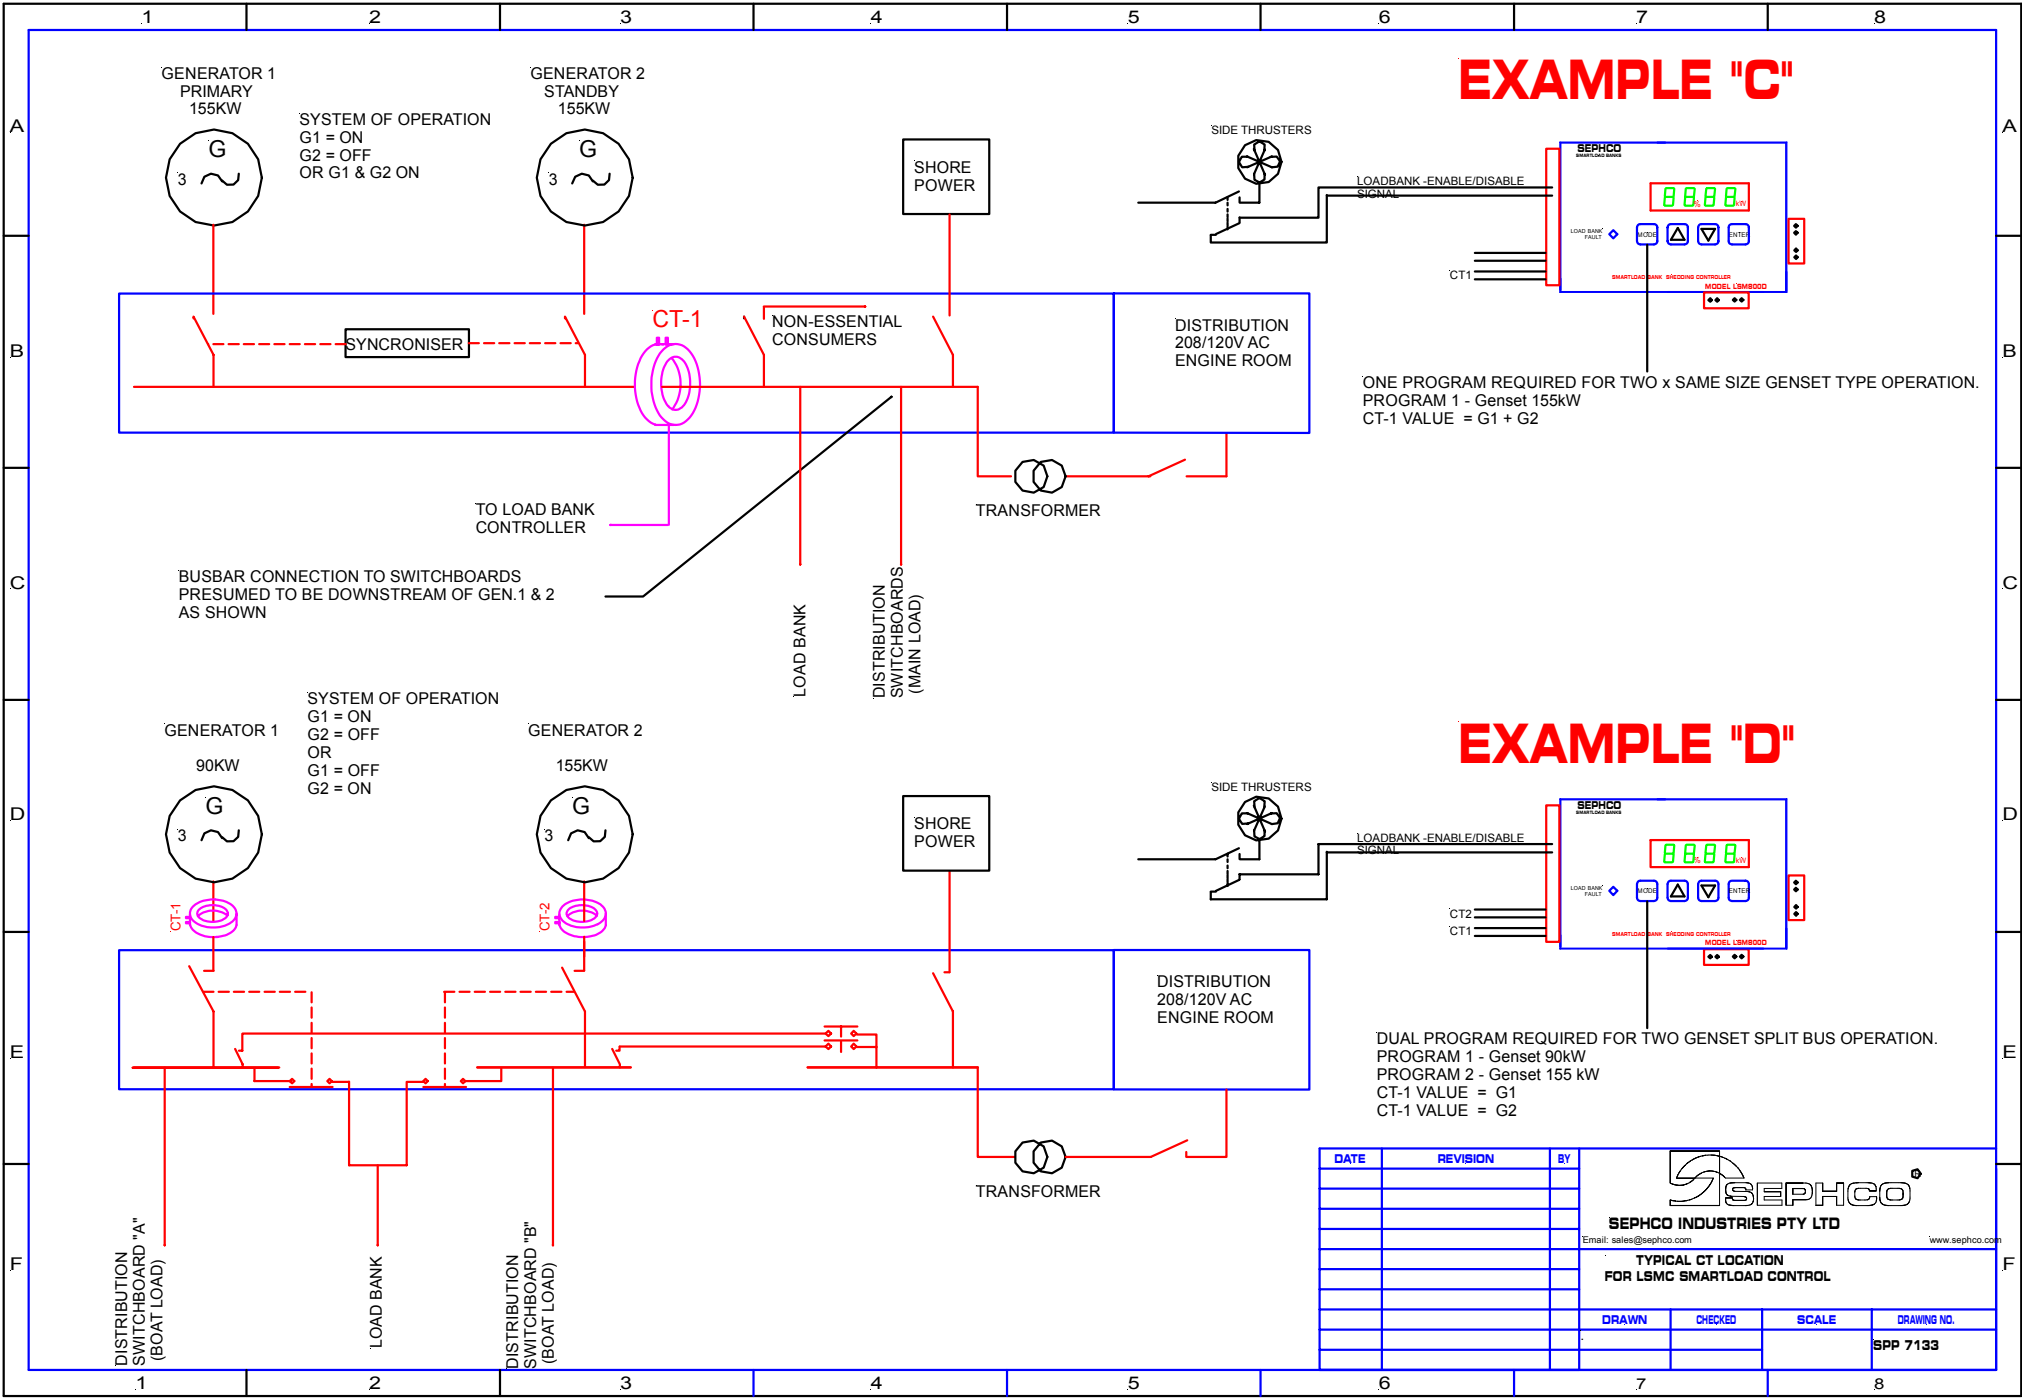

DATE	REVISION	BY



SEPHCO
 SEPHCO INDUSTRIES PTY LTD
 Email: sales@sephco.com www.sephco.com

TYPICAL CT LOCATION FOR LSMC SMARTLOAD CONTROL

DRAWN	CHECKED	SCALE	DRAWING NO.
			SPP 7133

